



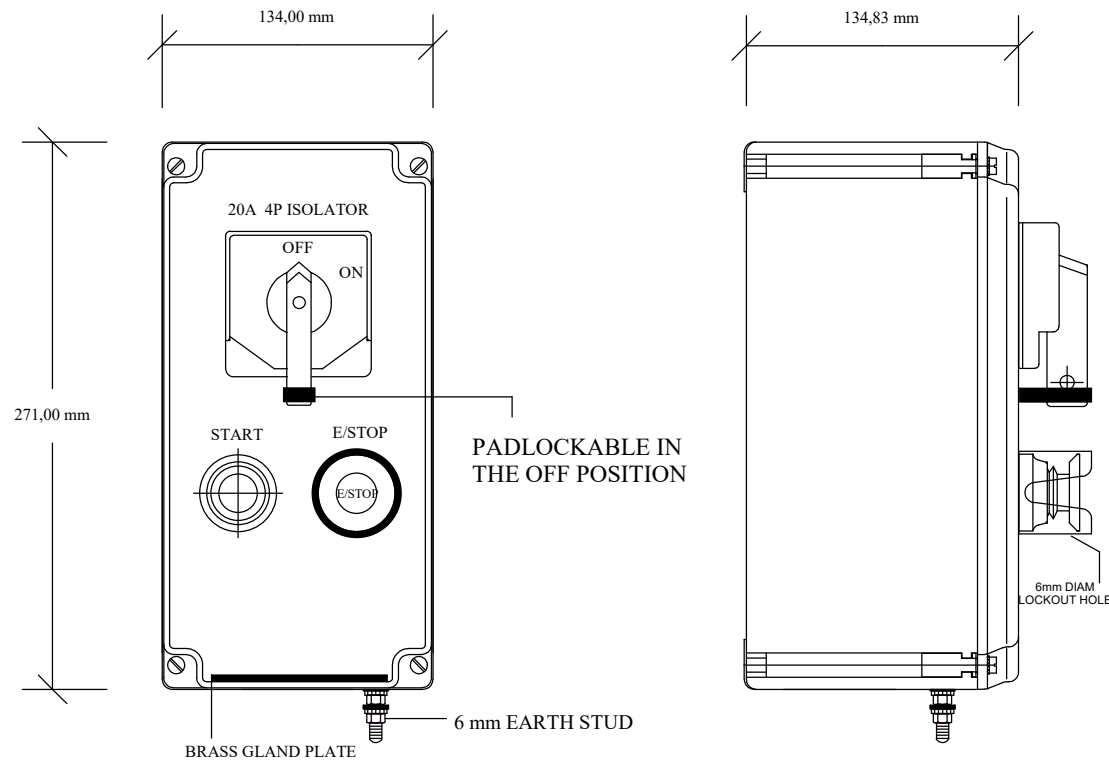

SWITCHING ARRANGEMENT

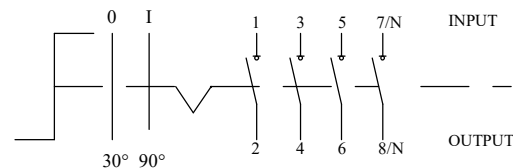

INDEX


1 X GHG 444 Ex de CONTROL STATION

1 X ISOLATOR 20A / 400VAC
PADLOCKABLE IN OFF POSITION

2 X CONTACT BLOCKS 1NO-1NC
1 X START ACTUATOR
1 X E/STOP ACTUATOR LATCHING
1 X S/STEEL LOCKOUT

3 X M20 ENTRIES (1XBLANK)

BRASS GLAND PLATE
+EARTH STUD

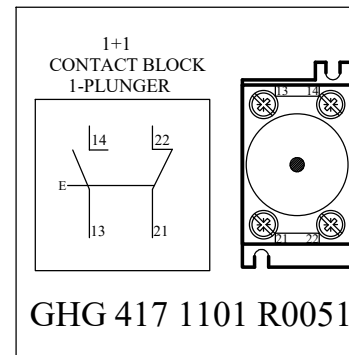

Drawing accepted by:

Signed:

Date:

Description: **CEAG** GHG 444 WITH 20A ISOL WITH START + E/STOP

Project **MASTER DRAWING**

Crouse-Hinds
by **EATON**

REF NO.
200116VM0945

CERTIFICATION
ZONE 1,2 / 21,22
IA No. S-XPL/04071

REVISION
REV.000

CONTACT
NEVILLE BELL
031 464 0023

EXB
YOUR HAZARDOUS AREA SOLUTION