

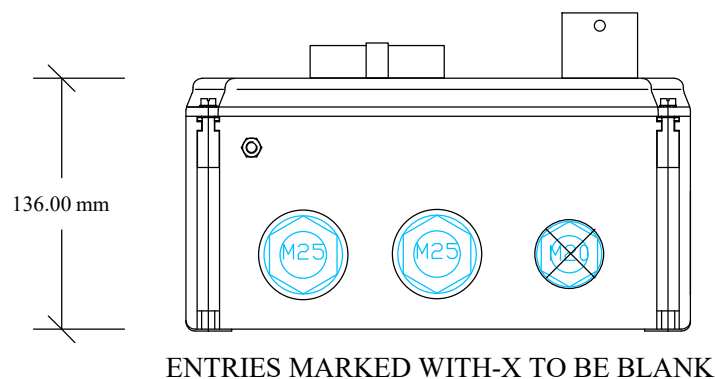


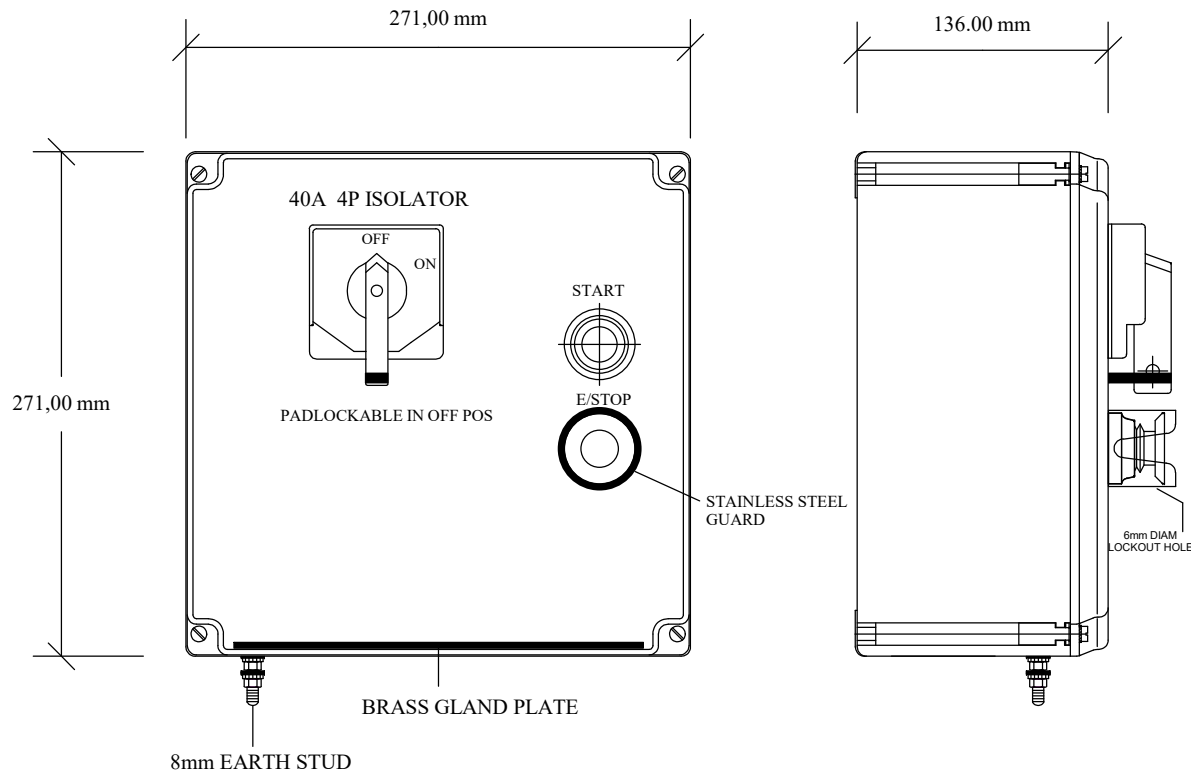

SWITCHING ARRANGEMENT

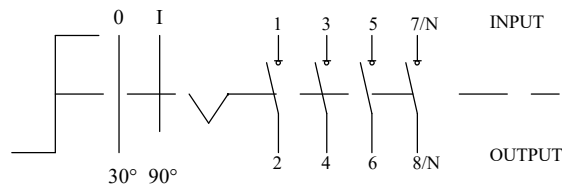

INDEX


1 X GHG 448 ENCLOSURE

1 X ISOLATOR 40A 4P 400V
GHG 260 1005 R0006
PADLOCKABLE IN OFF POSITION

1 X START ACTAUTOR
1 X E/STOP LATCHING ACTAUTOR
1 X S/STEEL LOCKOUT
2 X CONTACT BLOCKS (NO+NC)

1 X M20 TAPPED ENTRY(1 X BLANK)
2 X M25 TAPPED ENTRY

BRASS GLAND PLATE + 8MM EARTH STUD

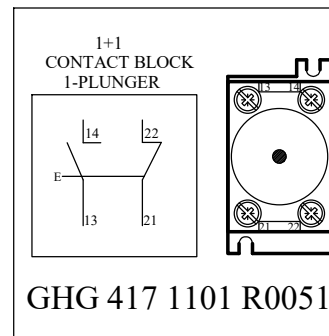

Drawing accepted by:

Signed:

Date:

Description: **CEAG** 40AMP 4POLE ISOLATOR CONTROL STATION WITH START AND STOP PB

Project: **MASTER DRAWING**

Crouse-Hinds
by **EATON**

REF NO.
200116VM1029

CERTIFICATION
ZONE 1,2/21,22
IA No. S-XPL/04072

REVISION
REV.000

CONTACT
NEVILLE BELL
031 464 0023

EXB
YOUR HAZARDOUS AREA SOLUTION